

SOUTHAMPTON FIRE COMPANY NO 1
SOUTHAMPTON, PA



S.O.147720 / Q124833

PUMPER
TYPHOON 4X2 CHASSIS


2000 GPM HALE QMAX PUMP			HOSE LOAD:		
780 GALLON WATER TANK			500' OF 3.00" DJ		
			1500' OF 5.00" LDH		
COMPT.	OPENING		INTERIOR DIMENSION		
L1/R1	60W	68H	60W	12H	12D UPPER
			60W	56H	26D LOWER
L2/R2	56W	34H	56W	12H	12D UPPER
			56W	22H	26D LOWER
L3/R3	58W	59H	60W	3H	12D UPPER
			60W	56H	26D LOWER
B1	36W	16H	38W	28H	27D
THIS DRAWING IS FOR REFERENCE PURPOSES. ALL DIMENSIONS ARE SUBJECT TO MINOR VARIATIONS DUE TO MANUFACTURING PROCESSES.					
(FOR INTERNAL SALES PURPOSES ONLY)					
DEALER APPROVAL		DATE		☐ AS IS	
CUSTOMER APPROVAL		DATE		☐ WITH REVISIONS	

HOSEBED HEIGHT:
(FOR REFERENCE ONLY)
TO TAILBOARD: 47"
TO GROUND: 71±2"

LADDER HELD 12"
ABOVE TAILBOARD

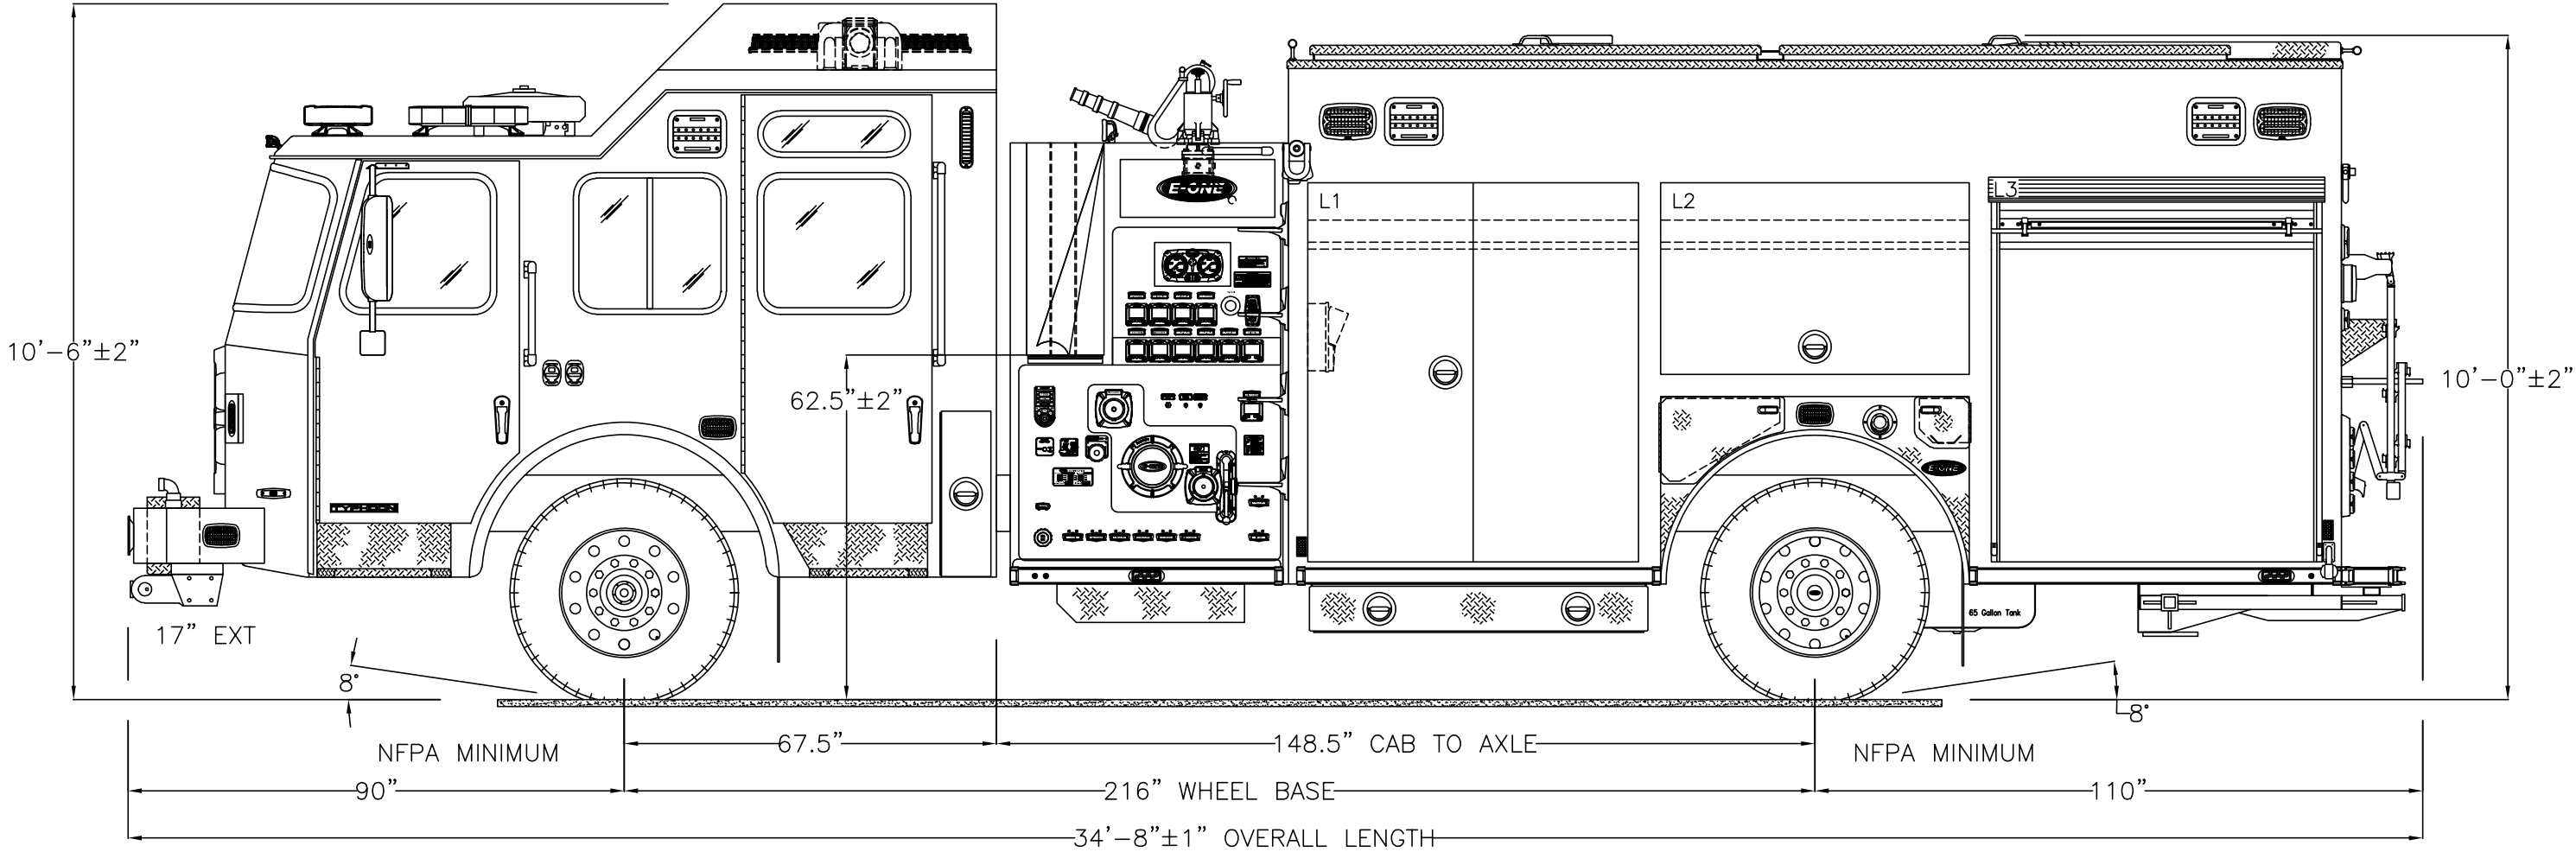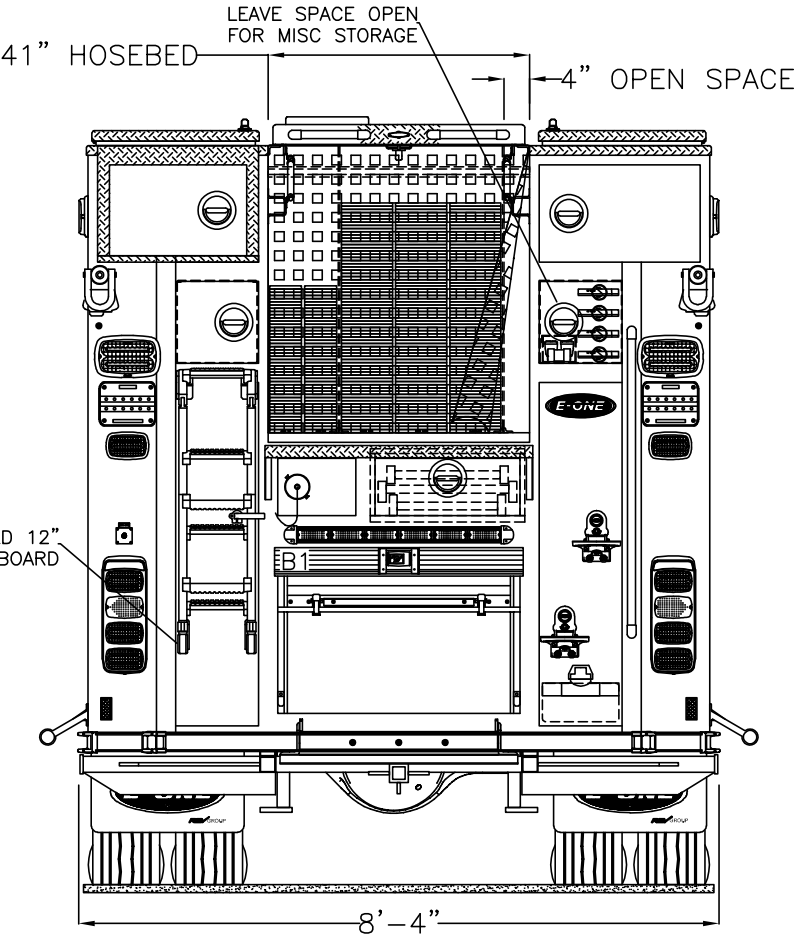

NGRIFFIN	A.3	ACTION ITEM 90035	2024-OCT-11	NGRIFFIN
DRAWN BY	REV	DESCRIPTION	DATE	APPROVED
APPROVAL REVISIONS				
SHEET 1 OF 2				



SOUTHAMPTON FIRE COMPANY NO 1
SOUTHAMPTON, PA
S.O.147720 / Q124833
PUMPER
TYPHOON 4X2 CHASSIS

THIS DRAWING IS FOR REFERENCE PURPOSES. ALL DIMENSIONS ARE
SUBJECT TO MINOR VARIATIONS DUE TO MANUFACTURING PROCESSES.

(FOR INTERNAL SALES PURPOSES ONLY)

DEALER APPROVAL



DATE

☐ AS IS

CUSTOMER APPROVAL

DATE

☐ WITH REVISIONS

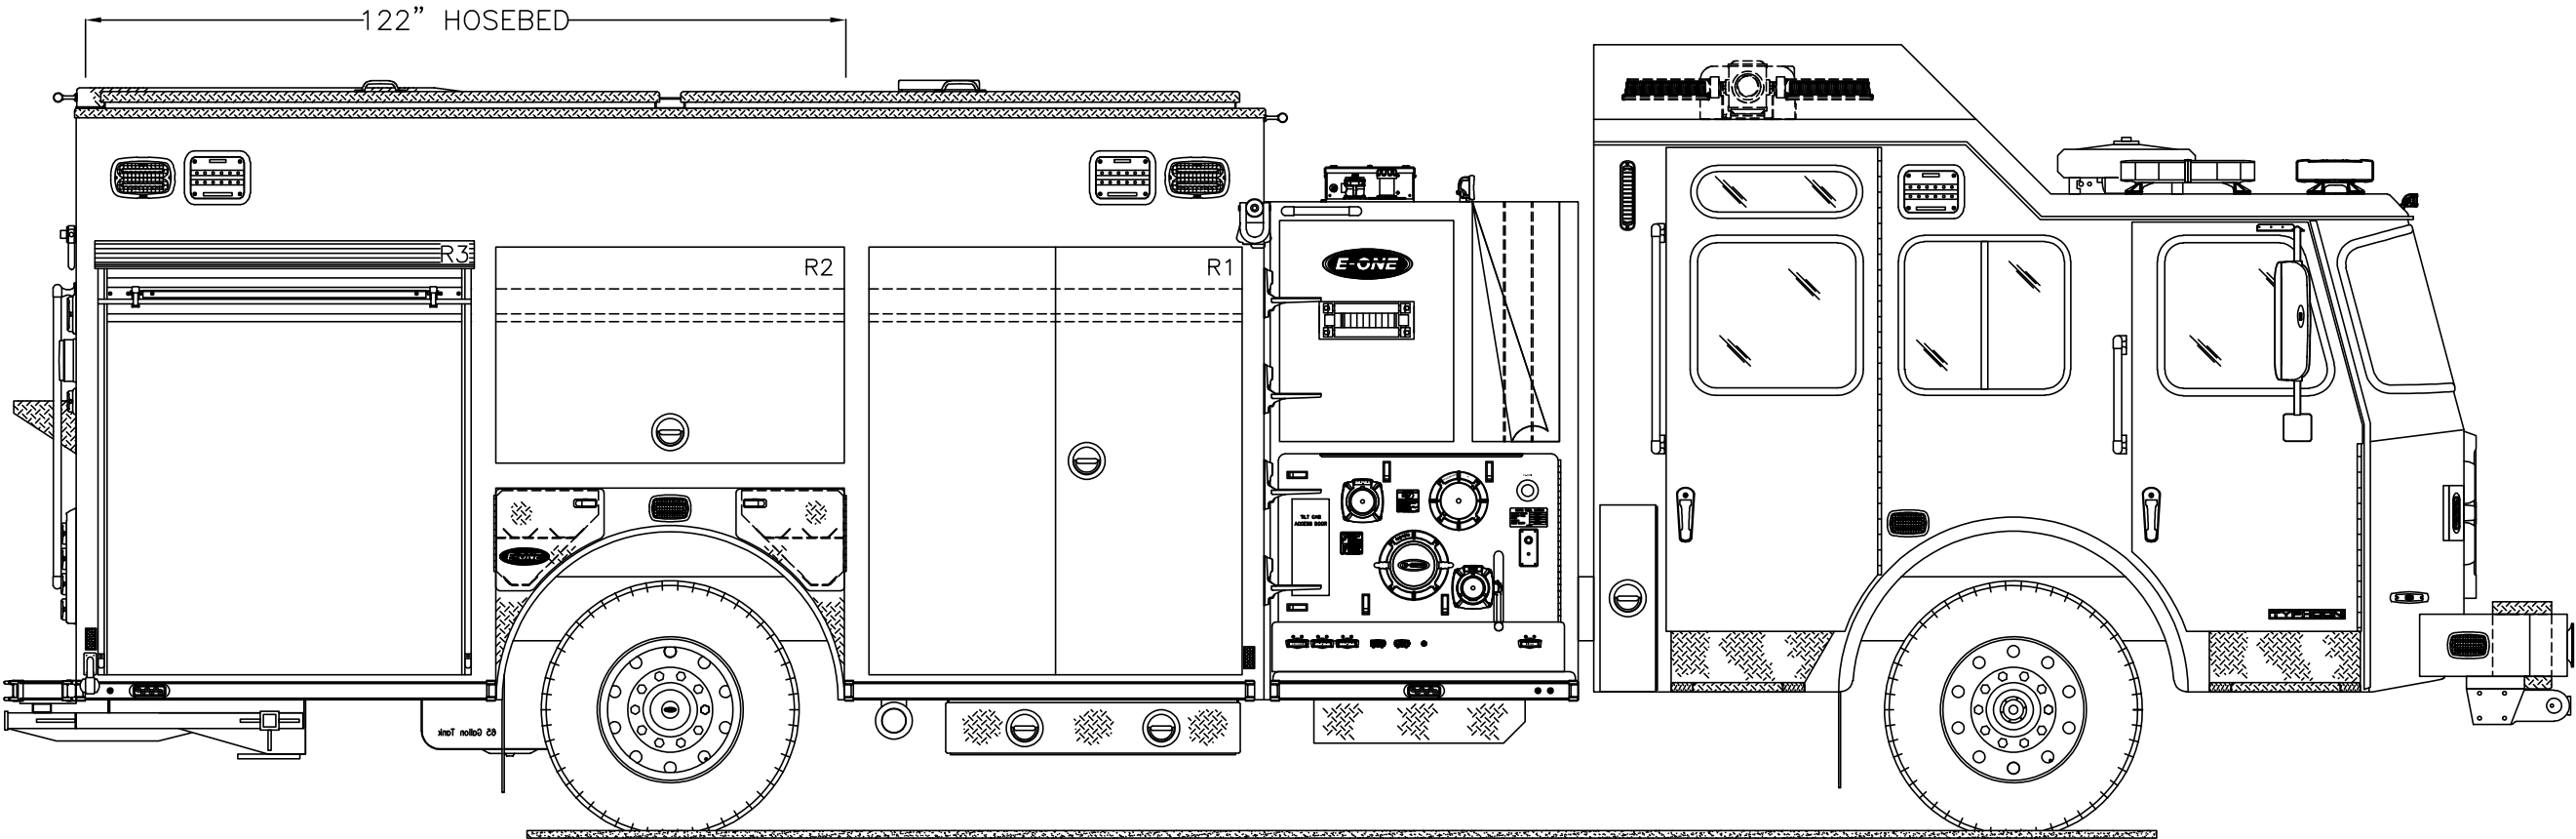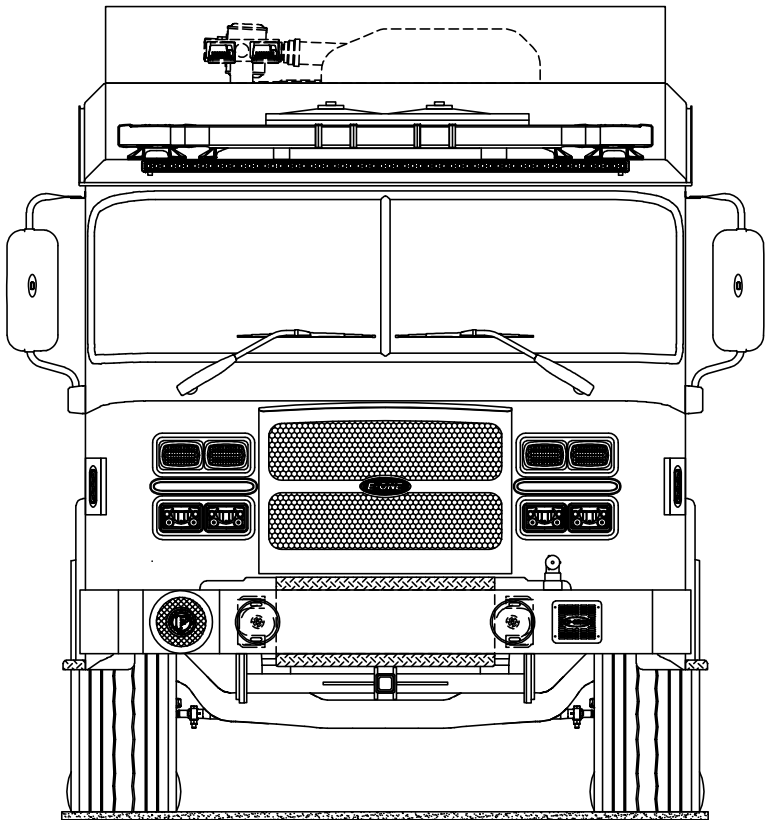

NGRIFFIN	A.3	ACTION ITEM 90035	2024-OCT-11	NGRIFFIN
DRAWN BY	REV	DESCRIPTION	DATE	APPROVED
		APPROVAL REVISIONS	SHEET 2 OF 2	